



THE CRITERIA THAT CONTROLS THE PIPE DESIGN DETERMINES THE METHOD FOR CALCULATING THE PIPE DESIGN RUNOFF

CRITERIA ① The pipe design hydraulic grade line (HGL) is based on unit flow rates, and must be 0.5 feet below the drop inlet.

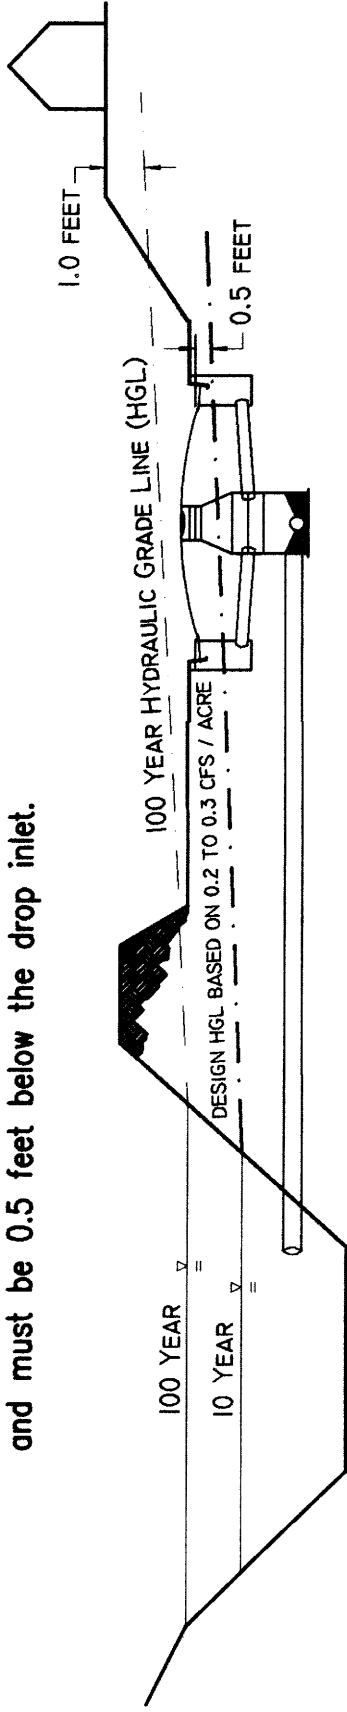

CRITERIA ② The pipe design 10 Year HGL is based on the Sacramento Method and must be no greater than 0.5 feet above the drop inlet.

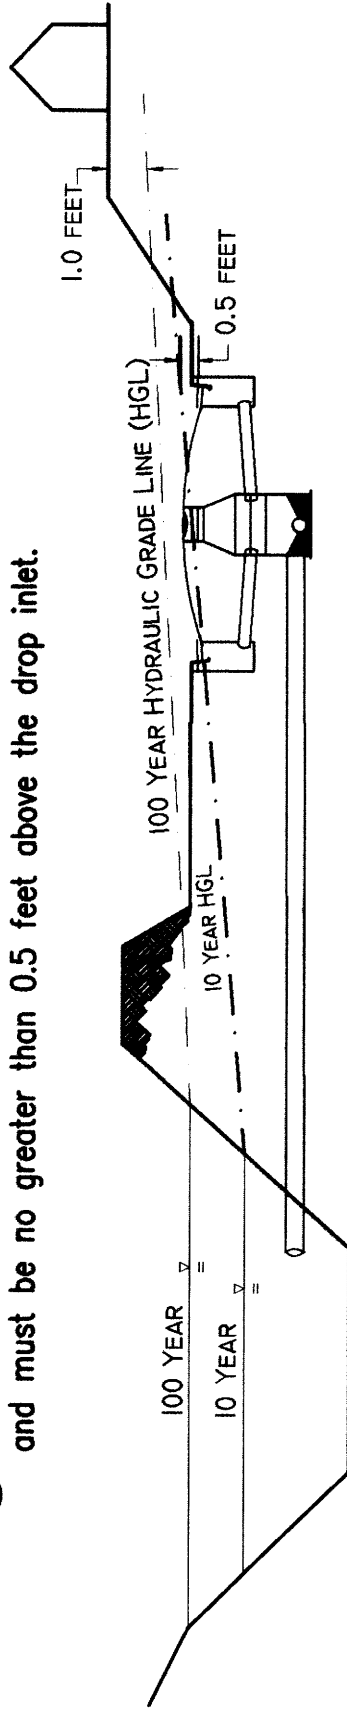

- Notes:
1. 10 and 100 Year design flows are based on the Sacramento Method unless otherwise directed by the City.
 2. The 100 Year HGL must be 1.0 feet below the house pad.

**City of Sacramento
Design Runoff Criteria
Infill Development**

Date **December 1996**

Figure **2-2**