


# MAXIMUM FLOOD DEPTH MAP

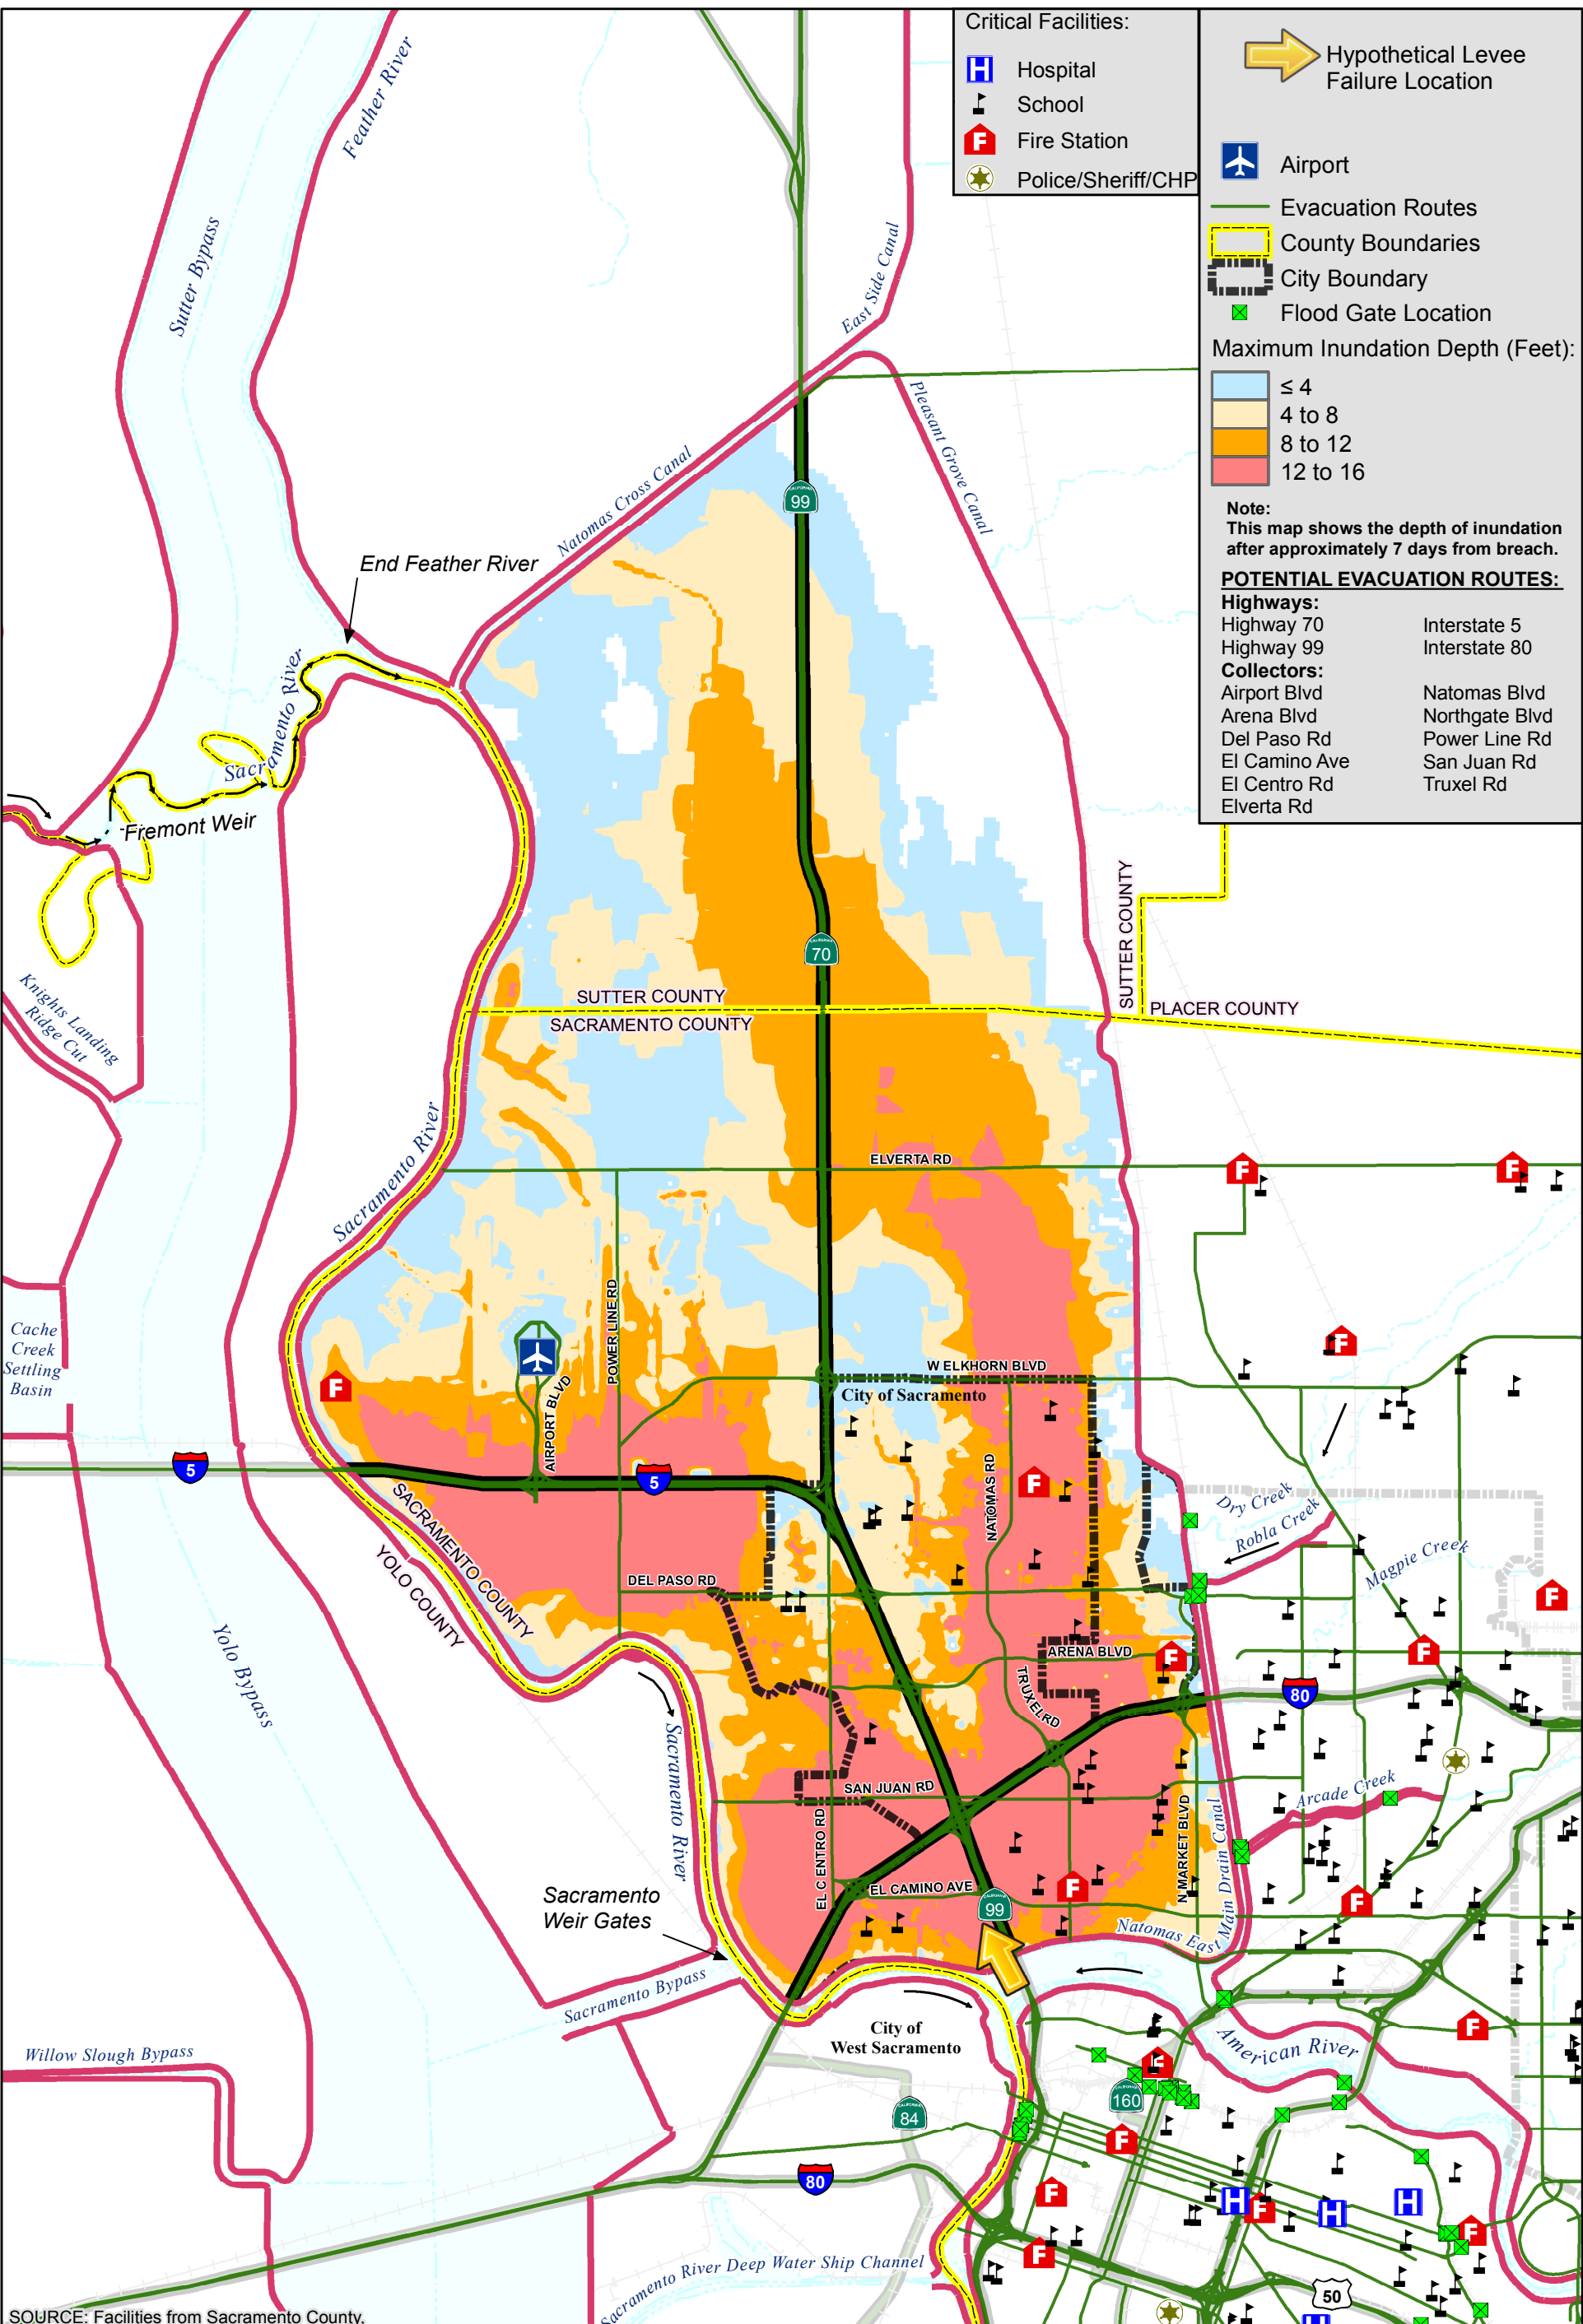

**Critical Facilities:**

- Hospital
- School
- Fire Station
- Police/Sheriff/CHP

Airport

Evacuation Routes

County Boundaries

City Boundary

Flood Gate Location

Hypothetical Levee Failure Location

**Maximum Inundation Depth (Feet):**

- ≤ 4
- 4 to 8
- 8 to 12
- 12 to 16


**Note:**  
This map shows the depth of inundation after approximately 7 days from breach.

**POTENTIAL EVACUATION ROUTES:**

**Highways:**  
Highway 70  
Highway 99  
Interstate 5  
Interstate 80

**Collectors:**  
Airport Blvd  
Arena Blvd  
Del Paso Rd  
El Camino Ave  
El Centro Rd  
Elverta Rd  
Natomas Blvd  
Northgate Blvd  
Power Line Rd  
San Juan Rd  
Truxel Rd

SOURCE: Facilities from Sacramento County,

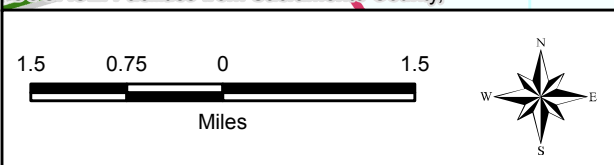

City/County of Sacramento  
Flood Emergency Evacuation Plan  
Sacramento County, California

Natomas Study Area



NATOMAS STUDY AREA  
MAXIMUM FLOOD DEPTHS  
BREACH #6 AT NEMDC RM 0.415  
POST-FOLSOM JFP

DECEMBER 2015

NAT\_B06A

26-Jan-2015 Z:\Projects\1411980\_CityofSacMaps\POST\_JFP\NAT\_B01\Figure1\_NAT\_B01\_Critical.mxd SET